

1. RE-BALANCE EXISTING AIR DEVICE TO AIR FLOW NOTED ON PLAN.
2. RE-BALANCE RELOCATED AIR DEVICE TO AIR FLOW NOTED ON PLAN.
3. PROVIDE NEW SUPPLY AIR DEVICE. SEE SHEET H02 FOR ADDITIONAL INFORMATION.
4. PROVIDE NEW DUCTWORK CONNECTED TO EXISTING MAIN.
5. RELOCATED THERMOSTAT, SEE SHEET HD-101 FOR ORIGINAL LOCATION. EXTEND CONTROL WIRING AS NECESSARY. VERIFY EXACT LOCATION IN FIELD WITH OWNER'S REPRESENTATIVE.
6. PROVIDE RETURN AIR DEVICES AND TRANSFER DUCT. REFER TO DETAIL ON SHEET H02.
7. PROVIDE DUCTLESS MINI-SPLIT HEAT PUMP SYSTEM. LOCATE INDOOR UNIT HIGH ON WALL ABOVE DOOR. LOCATE OUTDOOR UNIT ON ROOF 12" HIGH, COORDINATE EXACT LOCATION IN FIELD TO PROVIDE MINIMUM 10"-0" CLEARANCE FROM ROOF EDGE AND 5'-0" FROM EXISTING EQUIPMENT INCLUDING HVAC ROOF TOP UNITS AND SOLAR PANELS. PROVIDE EQUIPMENT SUPPORT RAILS AND PIPE CURB. ALL ROOF WORK BY GENERAL TRADES CONTRACTOR.
8. PROVIDE NEW THERMOSTAT FURNISHED WITH MINI-SPLIT HEAT PUMP SYSTEM. VERIFY EXACT LOCATION IN FIELD WITH OWNER'S REPRESENTATIVE.
9. PROVIDE CONDENSATE PUMP AND EXTEND DRAIN LINE TO THE MOP SINK. PROVIDE DRAINAGE TEES WITH CLEAN-OUT PLUGS AT ALL CHANGES IN DIRECTION.
10. PROVIDE RETURN AIR GRILLE AND DUCT STUB INTO RETURN AIR PLENUM ABOVE OFFICES.
11. PROVIDE REFRIGERANT PIPING FROM INDOOR TO OUTDOOR UNIT. SIZE PER MANUFACTURER'S INSTRUCTIONS.



221 North 4th St
Columbus, Ohio 43215
614-228-2122


2633 Erie Ave, Suite 12
Cincinnati, Ohio 45208
513-321-0444

CONSULTANTS

KOOI STRUCTURAL ENG.
Sunbury, Ohio 433074
614-218-1607

PRATER ENGINEERING

6130 Wilcox Rd
Dublin, Ohio 43016
614-766-4896

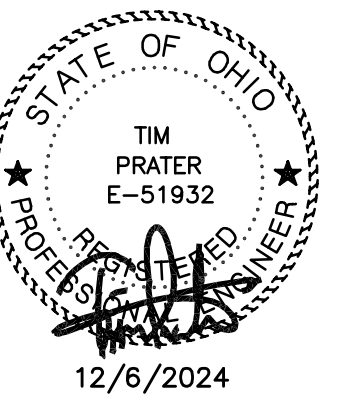

BEXLEY CITY HALL RENOVATIONS

2242 E Main St
Bexley, OH 43209

06.2024 DRAWING PRINT DATE

MARK	DATE	DESCRIPTION
	12.06.2024	PERMIT SET

FILE INFO

CAD FILE:

COPYRIGHT: GRA+D ARCHITECTS, 2024

SHEET SIZE: 24" x 36"

SHEET TITLE

NEW WORK
HVAC
PLAN

401

H01-24339.DWG

PRATER
Engineering Associates, Inc.

6130 Wilcox Road
Dublin, Ohio 43016

(614) 766 4896
erengineering.com

DESIGNED BY
N. GHOZAT

DRAWN BY
N. GHOZAT

CHECKED BY J. LOCKARD P.E.

JOB NUM.
24339