


ten
ten
and
the
re
re,
at,
at
he

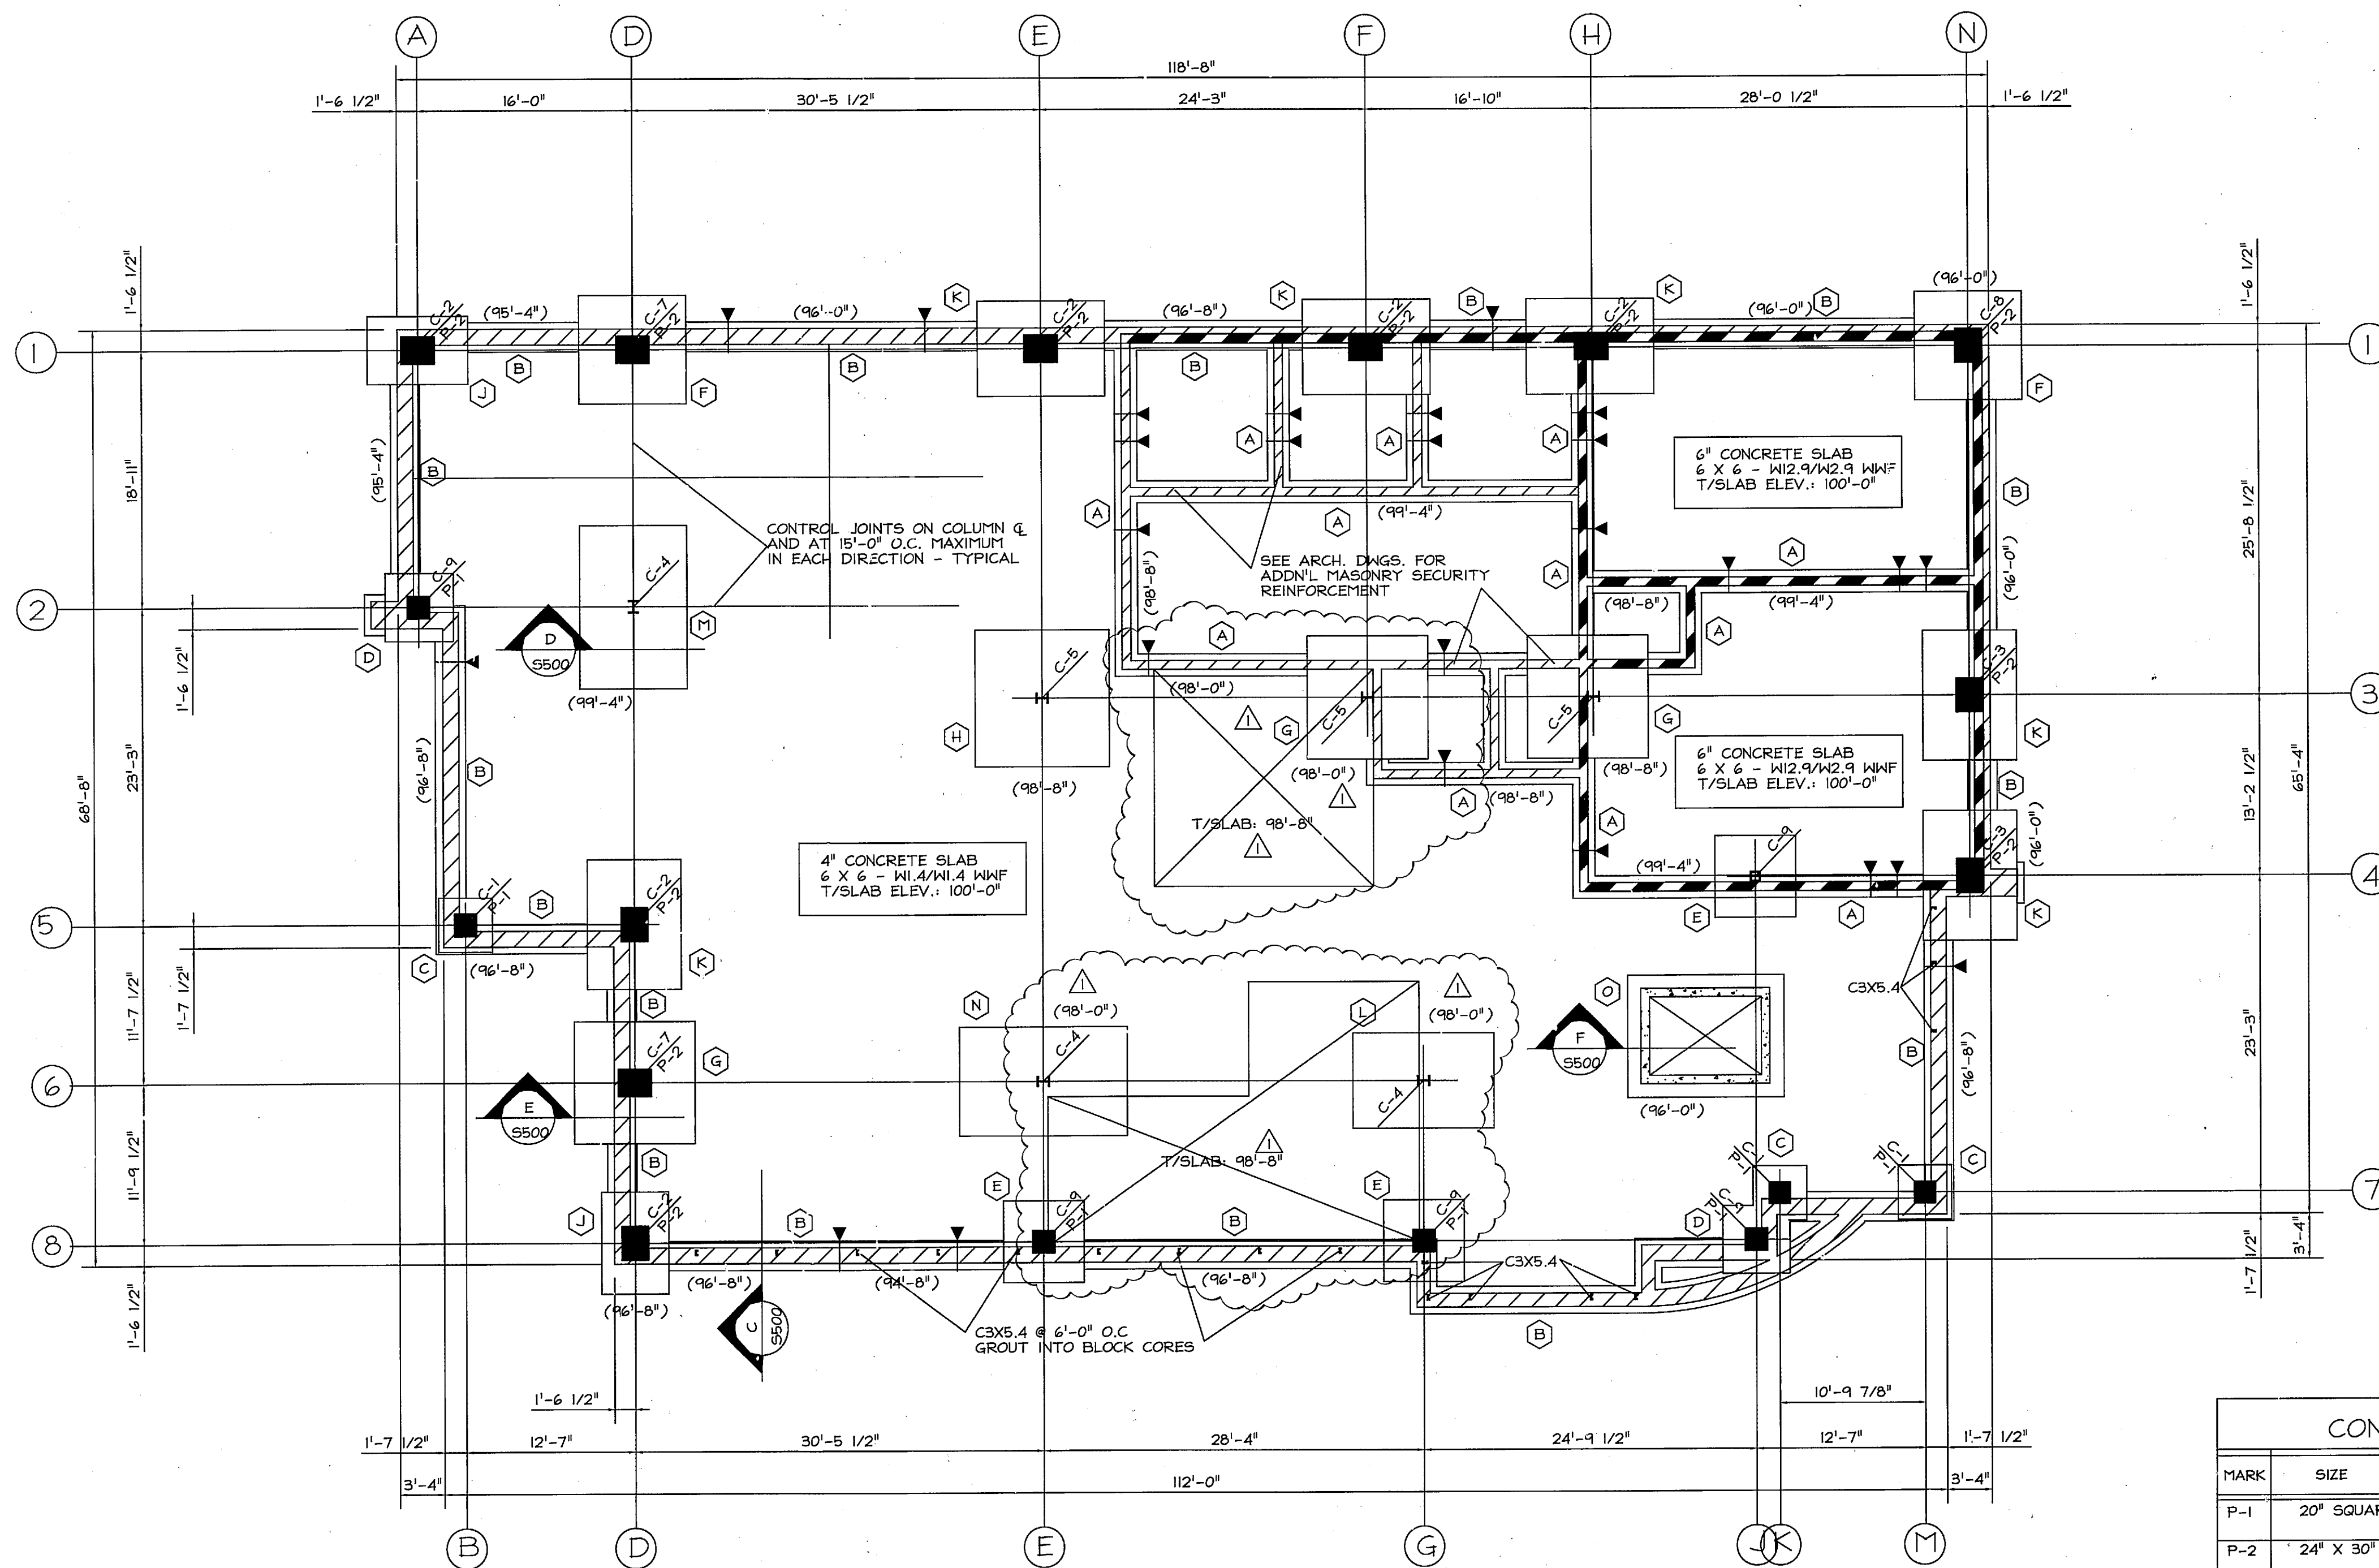

FOUNDATION PLAN

SCALE: 1/8" = 1'-0"

FOUNDATION DESIGN WAS BASED ON AN ALLOWABLE SOIL BEARING PRESSURE OF 3500 PSF AS RECOMMENDED IN THE SOILS INVESTIGATION PREPARED BY PROFESSIONAL SERVICES INDUSTRIES, DATED MAY 22, 2008.

ALL FOUNDATION EXCAVATIONS ARE TO BE INSPECTED AND APPROVED BY THE SOILS ENGINEER PRIOR TO THE INSTALLATION OF THE FOUNDATIONS.

FIGURES THUS () INDICATE TOP OF FOOTING ELEVATION.

FIGURES THUS ▼ INDICATE APPROXIMATE LOCATIONS OF STEPPED FOOTINGS.

FIGURES THUS ■ INDICATE REINFORCED CONCRETE MASONRY. PROVIDE #5 @ 32" O.C. VERTICAL GROUTED INTO BLOCK CORES FULL HEIGHT, DOWN TO FOOTING.

CONCRETE PIER SCHEDULE

MARK	SIZE	REINFORCEMENT
P-1	20" SQUARE	8- #5 VERTICAL, #3 @ 10" O.C.
P-2	24" X 30"	12- #7 VERTICAL, #3 @ 10" O.C.

FOOTING SCHEDULE

MARK	SIZE	DEPTH	REINFORCEMENT
Ⓐ	1'-6" WIDE	1'-0"	2- #5 CONT.
Ⓑ	2'-0" WIDE	1'-0"	3- #5 CONT.
Ⓒ	4'-0" SQUARE	1'-0"	4- #5 EACH WAY
Ⓓ	5'-0" SQUARE	1'-4"	6- #5 EACH WAY
Ⓔ	6'-0" SQUARE	1'-4"	7- #5 EACH WAY
Ⓕ	8'-0" SQUARE	1'-6"	8- #6 EACH WAY
Ⓖ	9'-0" SQUARE	1'-8"	10- #6 EACH WAY
Ⓘ	10'-0" SQUARE	2'-0"	12- #6 EACH WAY
Ⓚ	5'-0" X 7'-6"	1'-4"	6- #6 EACH WAY
Ⓛ	7'-0" X 9'-6"	1'-6"	9- #6 EACH WAY
Ⓜ	7'-0" X 10'-6"	2'-9"	13- #7 EACH WAY
Ⓝ	8'-0" X 12'-6"	2'-4"	13- #7 EACH WAY
Ⓞ	8'-0" X 12'-6"	2'-9"	15- #7 EACH WAY
Ⓟ	9'-0" X 11'-8"	1'-6"	11- #6 EACH WAY
Ⓠ			
Ⓡ			
Ⓢ			
Ⓣ			

BEXLEY POLICE FACILITY
559 NORTH CASSINGHAM ROAD
BEXLEY, OHIO 43209

05/05/2008
BIDDING & PERMIT DOCUMENTS
CONSTRUCTION DOCUMENTS
ADDENDUM 8-20-08

PROJECT NO.: BX106

S100